SPECIFICATIONS (OS-750-SS-CS3)

- 6" inlet/outlet connections, 4" vent connection.
- Max flow rate: 314 GPM 2.
- Liquid capacity: 750 Gallons (100 cu. ft.); Oil: 646 gal.; Sand: 30 gal. 3.
- Unit weight w/std. covers: 1484 lbs. 4.
- 5. Highway traffic load rated, bolted, gas/water tight composite covers. (16,000 lbs)
- Maximum operating temperature 140°F continuous. 6.
- 7. Slick Stick[™] Oil Monitoring System (see page 2).

NOTES

- 1. 1" thick high density polyethylene walls.
- 2. Unit supplied with built-in adapter(s) for up to 3 1/2" of adjustability. Additional riser(s) available for deeper burial depth.
- 3. For buried applications.
- 4. Lifting lug set included for easy install.

ENGINEER SPECIFICATION GUIDE

Striem oil separator model OS-750-SS-CS3 shall be lifetime guaranteed and made in USA of High Density Polyethylene with minimum 1" uniform wall thickness. Separator shall be furnished for below grade installation with field adjustable riser system. Separator shall be furnished with an oil level monitoring system. Separator flow rate shall be 314 GPM. Separator oil capacity shall be 646 gallons. Sand capacity shall be 30 gallons. Cover shall provide water/gas-tight seal and have a maximum 16,000 lbs load capacity.

THIRD PARTY STRUCTURAL ANALYSIS

The OS-750-SS-CS3 has been structurally analyzed in accordance with the requirements of IBC 2012 and ASCE/SEI 7 for direct burial. The maximum burial depth and backfill material are specified in our installation instructions. The structural design has been reviewed and sealed by a professional engineer registered in the state of California. A sealed structural analysis report is available upon request.

OPTIONS

- 4M 4" Male Thread Inlet / Outlet
- 4P 4" Plain End Inlet / Outlet
- 6M 6" Male Thread Inlet / Outlet
- 8P 8" Plain End Inlet / Outlet
- C24-HP (2) H20 Rated Pickable Cast Iron Covers
- HDK-1 High Water Table Hold Down Kit

TeleGlide RISER OPTIONS

- **SR24** (2) >3-1/2"-22"
- LR24 (2) >22"-37"
- **SR24** (4) >37"-41"
- SR24 (2) + LR24 (2) >41"-56"
- **LR24** (4) >56"-70"

Clean Sweep[™] polypropylene coalescing media has been third party tested to performance standard CEN EN858-1 for class 1 coalescing separators.



Signature of Approval: _____

Company: _____


Date of Approval: _____


Specifying Engineer: _____


Engineering Firm: _____

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF **STRIEM**, LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF **STRIEM**, LLC. IS PROHIBITED.

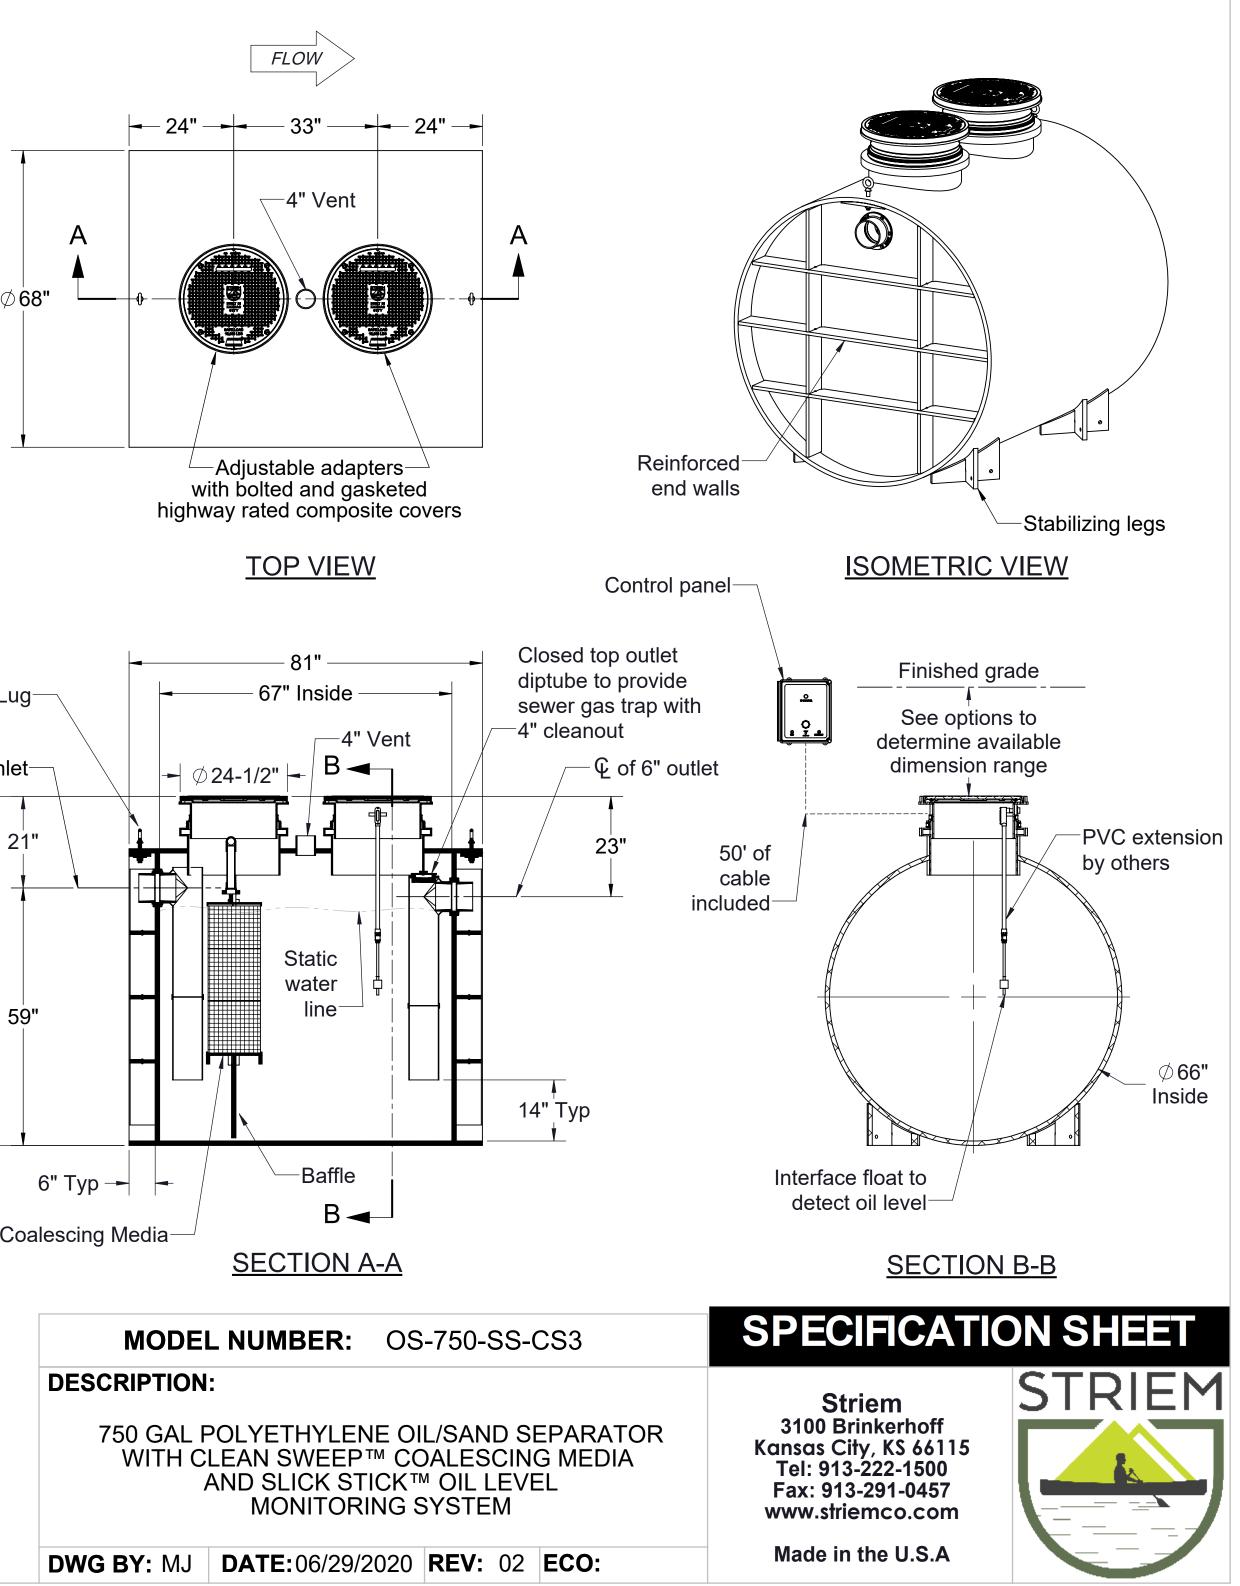

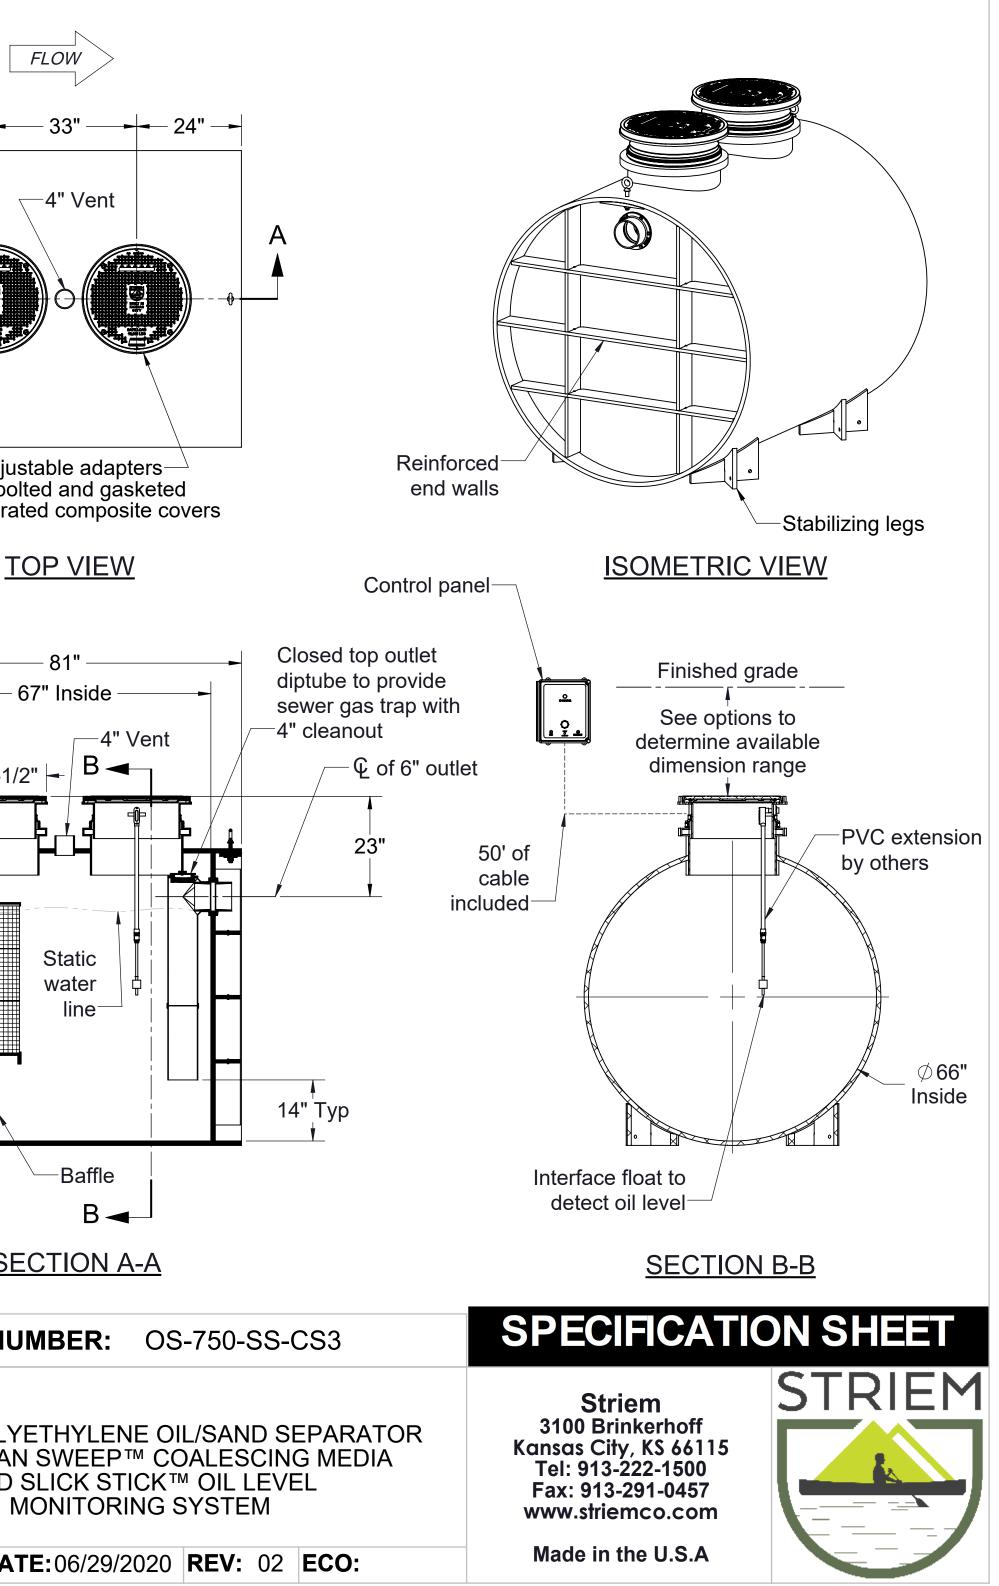

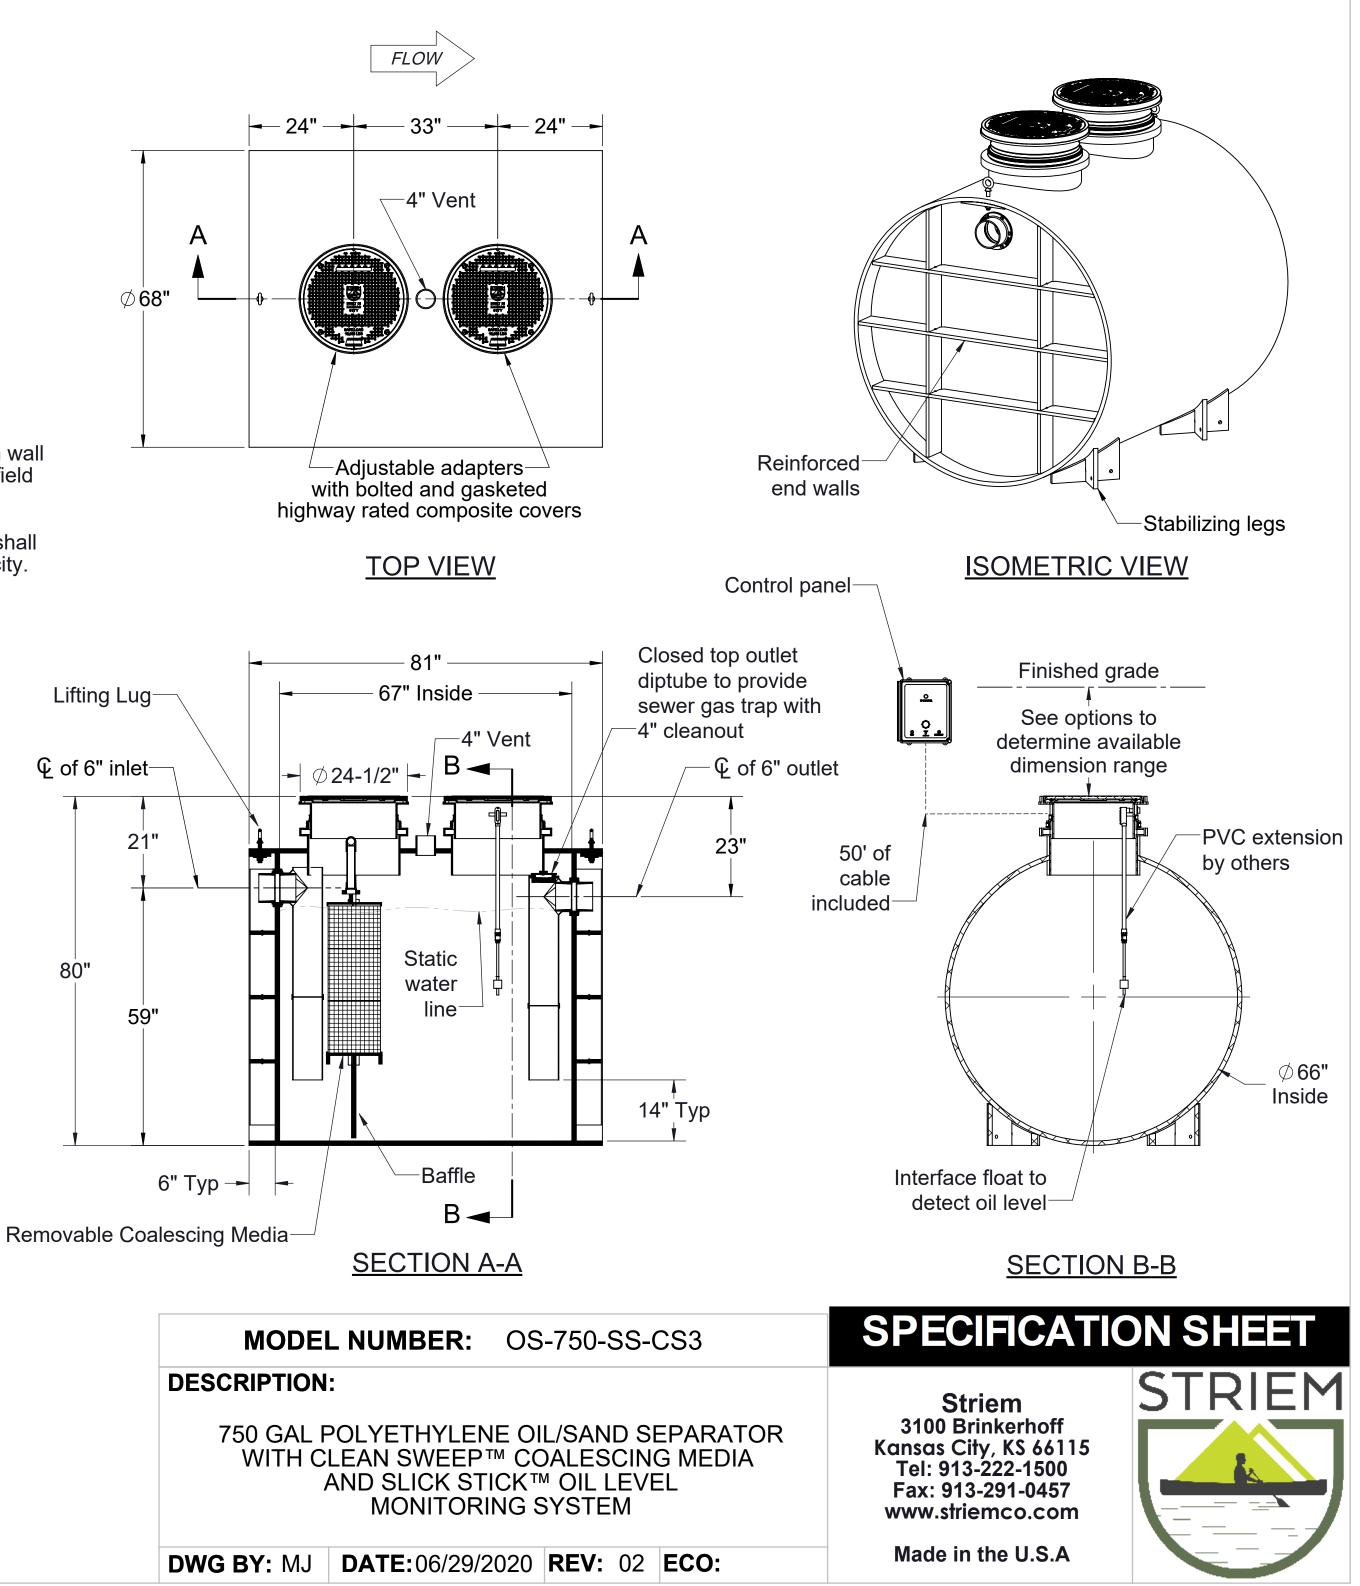

MODEL NUMBEI


SPECIFICATIONS


- 1. UL Listed


- OL LISTED
 Provides warning of high oil level conditions with interface float.
 Single phase, 120 volt, 60 hertz power required.
 NEMA 4X fiberglass, corrosion resistant, weatherproof enclosure suitable for outdoor use and damp environments.
 Audible Alarm Buzzer, 95dB pulsing horn with no timeout.
 High Oil Light, indicates oil has accumulated below the oil interface float.

- float or the tank liquid level is below the High Oil Interface Float.
 Power On light inside enclosure. Visible from the outside. Green light indicates the power is on.
 Horn off button that silences the audible alarm when pressed.
 Test button that when pressed will test the system electronics.

- Locking clasp on door.
 Alarm bell stays on until reset. Light stays on until reset, even if level goes down.
- 12. Unit comes supplied with extra dry contact for connection to a building alarm system.

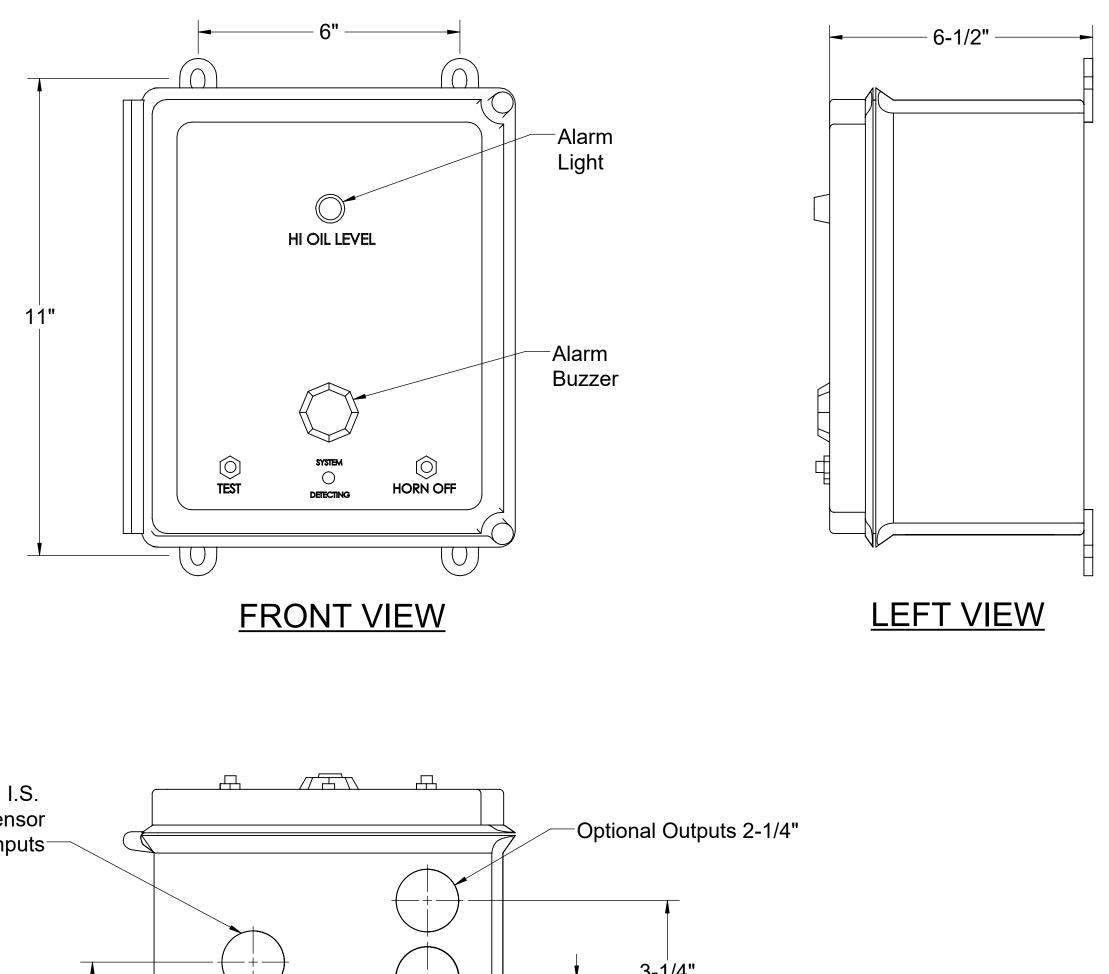

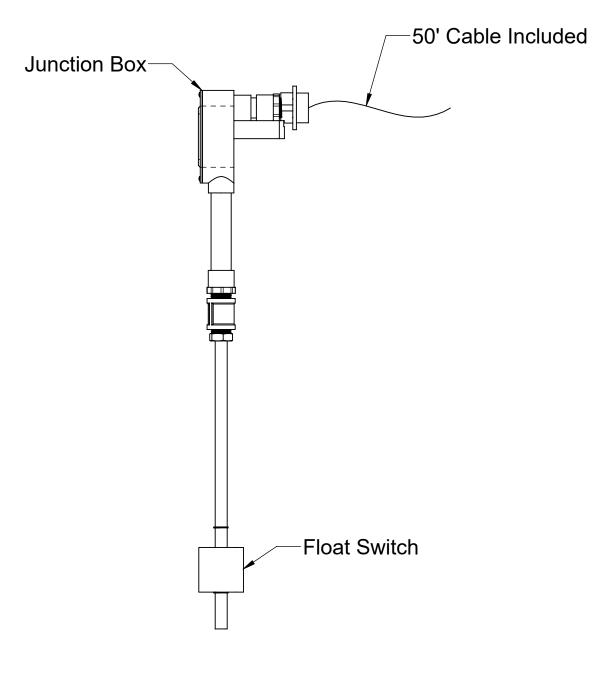

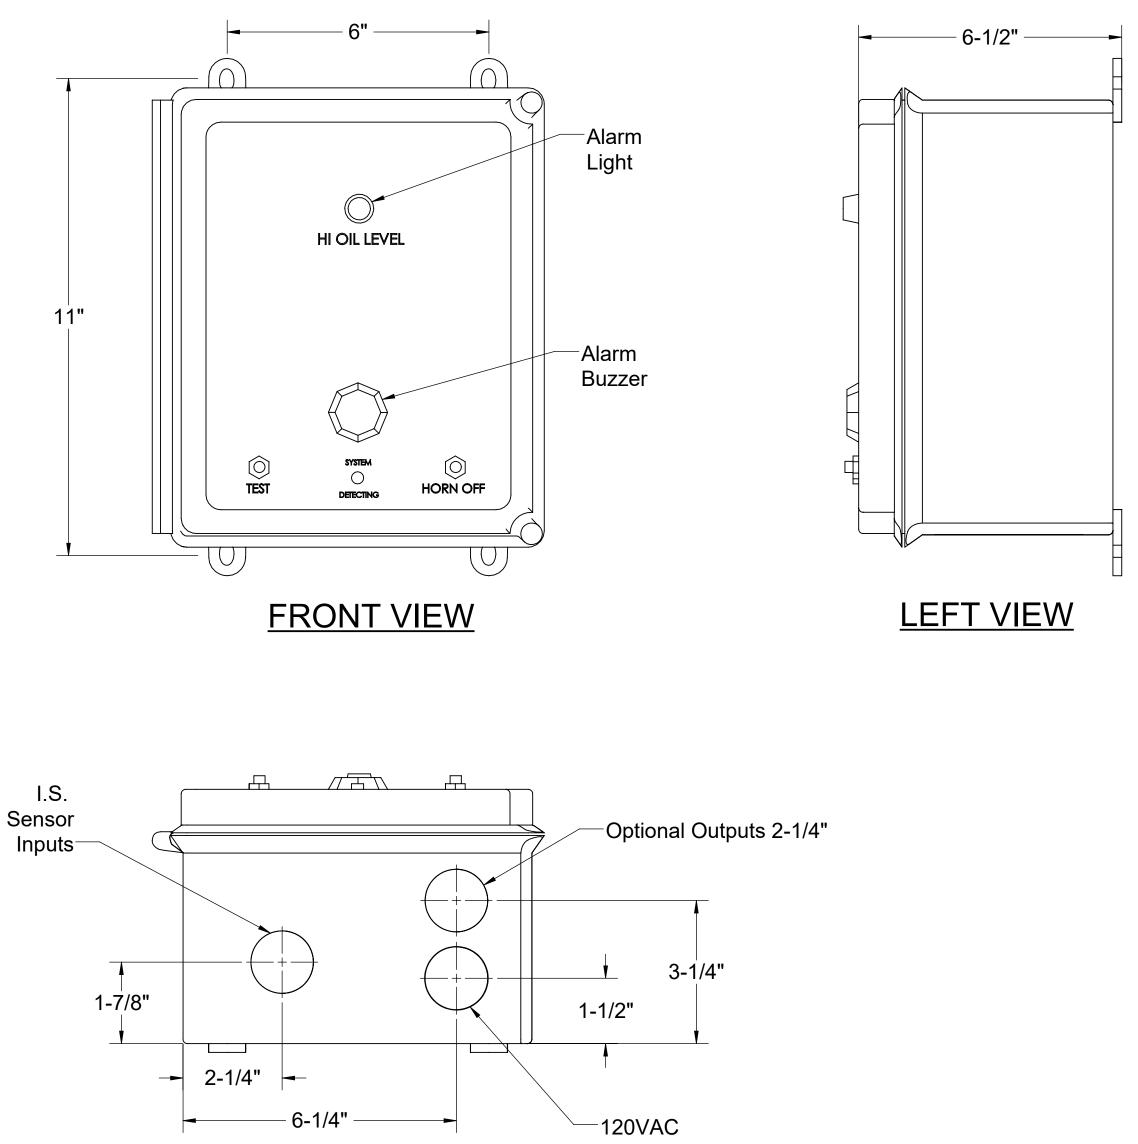

Input Power **BOTTOM VIEW**

MODEL NUMBER: 8056-001-01			SPECIFICATION SHEE	
DESCRIPTION: SLICK STICK MONITORIN FOR OS-50, OS OS-750, OS-10	G SYSTEM S-75. OS-100		Striem 3100 Brinkerhoff Kansas City, KS 66115 Tel: 913-222-1500 Fax: 913-291-0457 www.striemco.com	
DWG BY: MJ DATE: 06/29/20	20 REV : 02	ECO:	Made in the U.S.A	

Installation Guidelines:

- 1. The Slick Stick[™] interface float and alarm panel will ship separately from the tank.
- Install the 1/2" FPT brass coupling to the end of the Slick Stick™ interface float. Thread the 1/2" MPT x socket PVC fitting into the 1/2" FPT brass coupling.
 If the tank is to be installed above grade, or without
- any adjustment to the adapter, install a length of 1/2" sch. 40 PVC pipe between the bottom of the junction box and the top of the 1/2" MPT x socket PVC fitting. Choose the length from Table 1 that corresponds with the unit, and oil capacity to be monitored.
- If the tank is buried, and the adapter will be adjusted 4. upward and/or risers will be used, add the total upward extension dimension to the length determined from Table 1 to determine total length of 1/2" PVC pipe length. For example, assume an OS-75 is being installed below grade and requires 26" of riser extension. Assume you want the control panel to alarm when the oil capacity reaches 70% of the total oil capacity. The length of the 1/2" PVC pipe extension should be 26" (riser depth) + 10" (from Table 1) = 36".
- 5. Run interface float wiring through 1/2" PVC pipe and into the bottom of the juntion box inside the adapter. Connect wiring to alarm panel (see wire diagram).

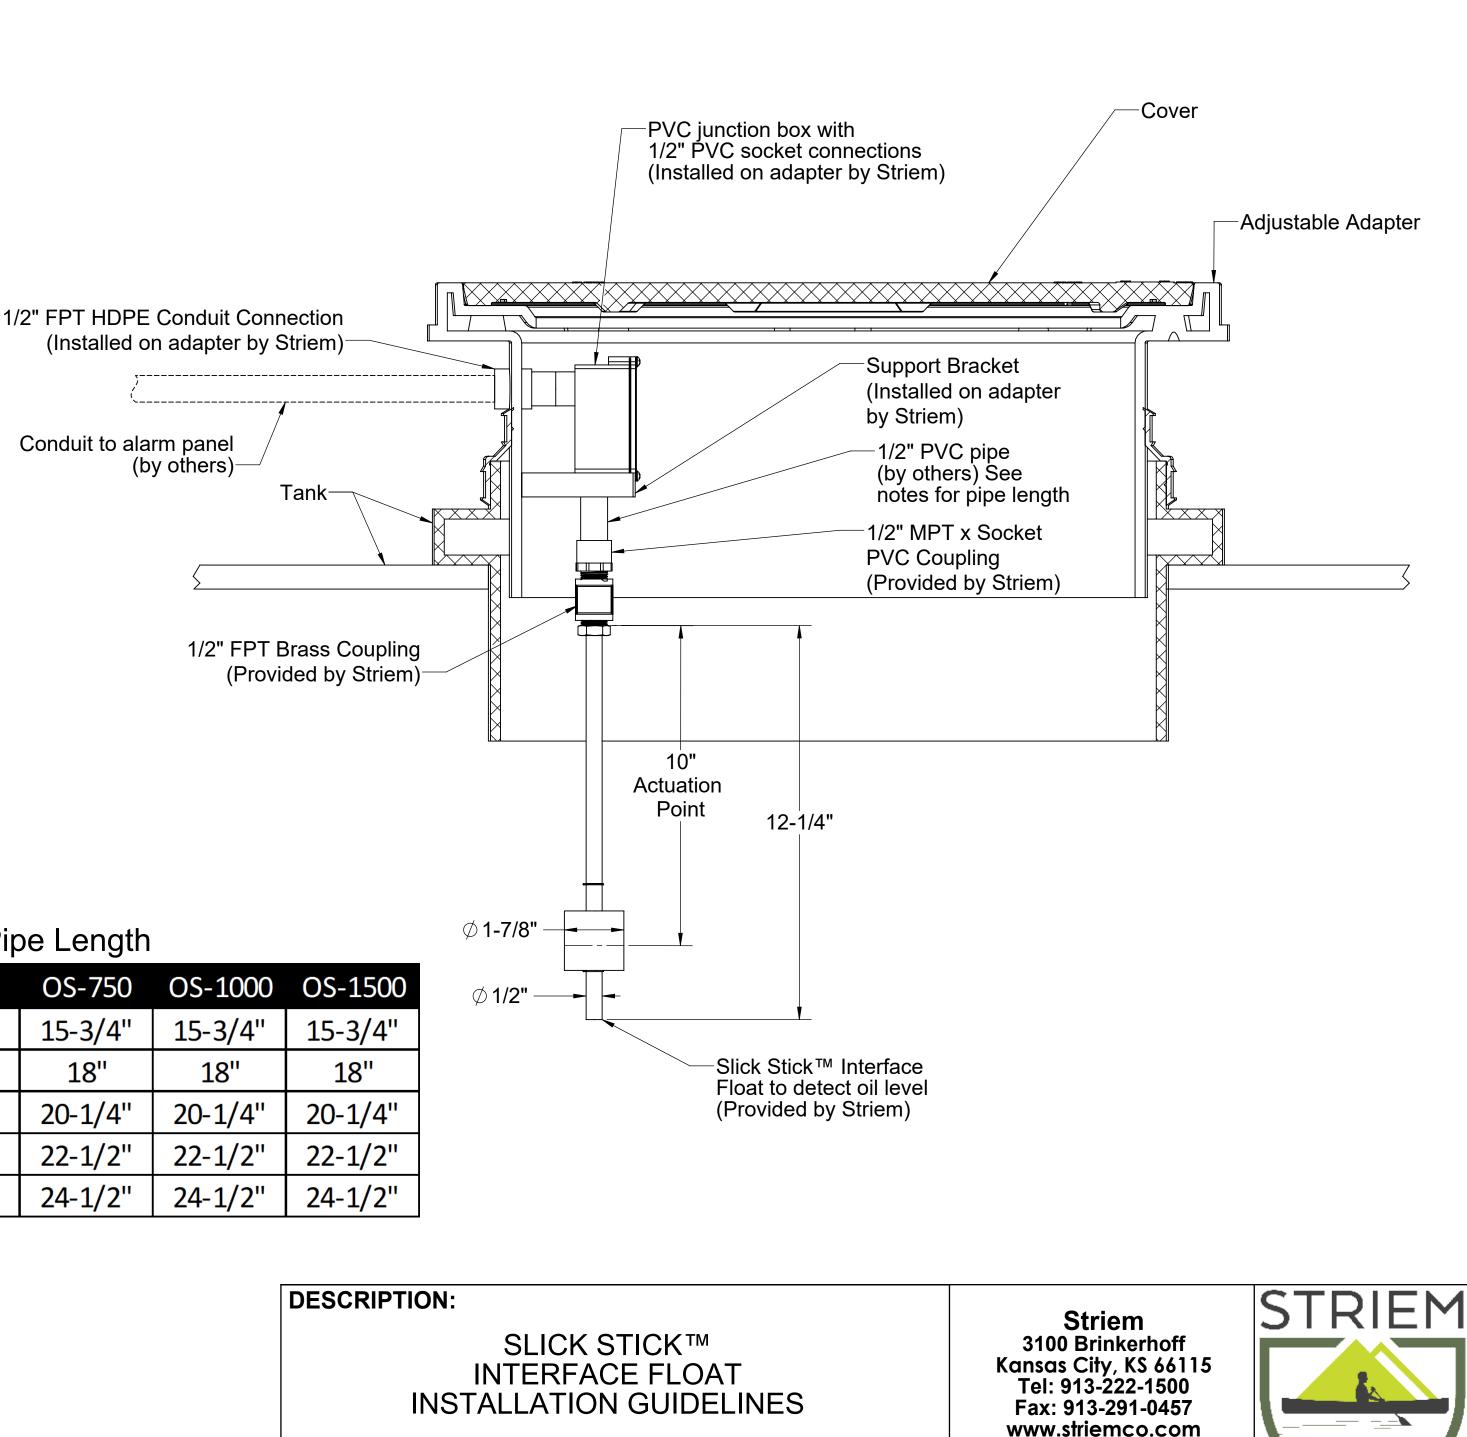


Table 1: 1/2" PVC Pipe Length									
Oil Capacity	OS-50	OS-75	OS-100	OS-750	OS-1000	OS-1500			
50%	1-1/2"	6-5/8"	9-5/8"	15-3/4"	15-3/4"	15-3/4"			
60%	2-3/8"	8-1/4"	11-1/2"	18"	18"	18"			
70%	3-3/8"	10"	13-1/4"	20-1/4"	20-1/4"	20-1/4"			
80%	4-3/8"	12"	15"	22-1/2"	22-1/2"	22-1/2"			
90%	5-1/2"	13-7/8"	18-3/4"	24-1/2"	24-1/2"	24-1/2"			

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF **STRIEM**, **LLC**. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF **STRIEM**, **LLC**. IS PROHIBITED.

DATE: 06/29/2020 **REV:** 02 **ECO:**

Made in the U.S.A