

EXCAVATION

1. Surrounding soil must be undisturbed soil or well compacted engineering fill.
2. Measure the width and length of the tank and excavate a hole that is a minimum of 18" greater than the tank on all sides.
3. Depth of excavation shall be 12" deeper than tank bottom.
4. After the excavation is complete create a well compacted support layer of aggregate mixture so that ground supporting tank is a minimum of 12" above native soil. Aggregate mixture must be 3/4" size clean rock or sand, with no fines. For compaction, use a flat plate compactor to tamper rock or sand evenly for 15 minutes.

UNIT INSTALLATION


1. Lower and center the unit into hole using Striem lifting lug kit (included). Do not use chains or accessways to move the unit.
2. Ensure tops of risers are level with finished grade.
3. Fill unit with water before backfilling to stabilize unit, check for leaks, and prevent float out during backfilling.

BACKFILLING & FINISHED CONCRETE SLAB

1. Before backfilling and pouring of slab secure covers and risers (if necessary) to the unit.
2. Backfill evenly all around tank using crushed aggregate material approximately 3/4" size rock, or sand, with no fines.
3. When backfilling ensure backfill is worked under the unit using a probe to ensure the unit is fully supported.
4. Place 6" aggregate base under slab. Aggregate should be 3/4" size rock, or sand, with no fines.
5. H2O rated slab required.
6. Concrete to be 28 day compressive strength to 4000 PSI with 6±1% air entrainment.
7. NO. 4 rebar (ϕ 1/2") grade 60 steel per ASTM A615: connected with tie wire.
8. Rebar to be 2 1/2" from edge of concrete.
9. Rebar spacing 12" grid. 4" spacing around access openings.

DEADMAN ANCHORING


1. Deadmen should be constructed as noted on Excavation and Backfill detail.
2. Deadmen should be 12" wide x 12" tall and equal to the length of the entire unit.
3. Each deadman should have 4 anchor points that each connect to a 3,500 lbs. rated turnbuckle.
4. Lay the deadmen parallel with the unit and ensure that they are outside the shadow of the tank.
5. Nylon straps rated to 3,333 lbs. each should be connected to a turnbuckle on each side. Turnbuckles should be secured to the deadmen anchor points on each side of the tank such that the tank is held down.

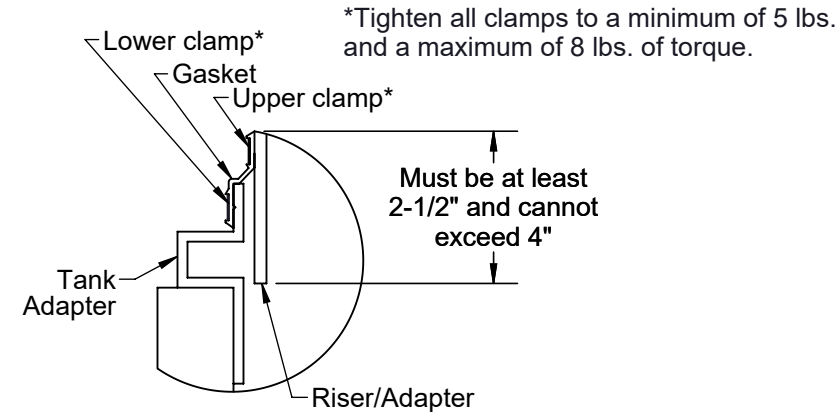

!!! ALL JCW INSPECTIONS SHALL BE REQUESTED ONLINE THROUGH THE WWW.MYGVERNMENTONLINE.ORG PORTAL !!!


!!! REFER TO JCW PERMIT FOR JCW INSPECTION REQUIREMENTS!!!

**Sand/Oil Separator Leak Test Inspection**  
-The separator leak test shall be performed after the H2O slab rebar configuration has been inspected.  
- Step 1: All pipes entering/exiting the separator shall be plugged.  
- Step 2: The separator shall be filled to finish grade at the top of the riser with water.  
- Step 3: The water level shall be marked by JCW and monitored for 30 minutes to confirm the separator is not leaking.

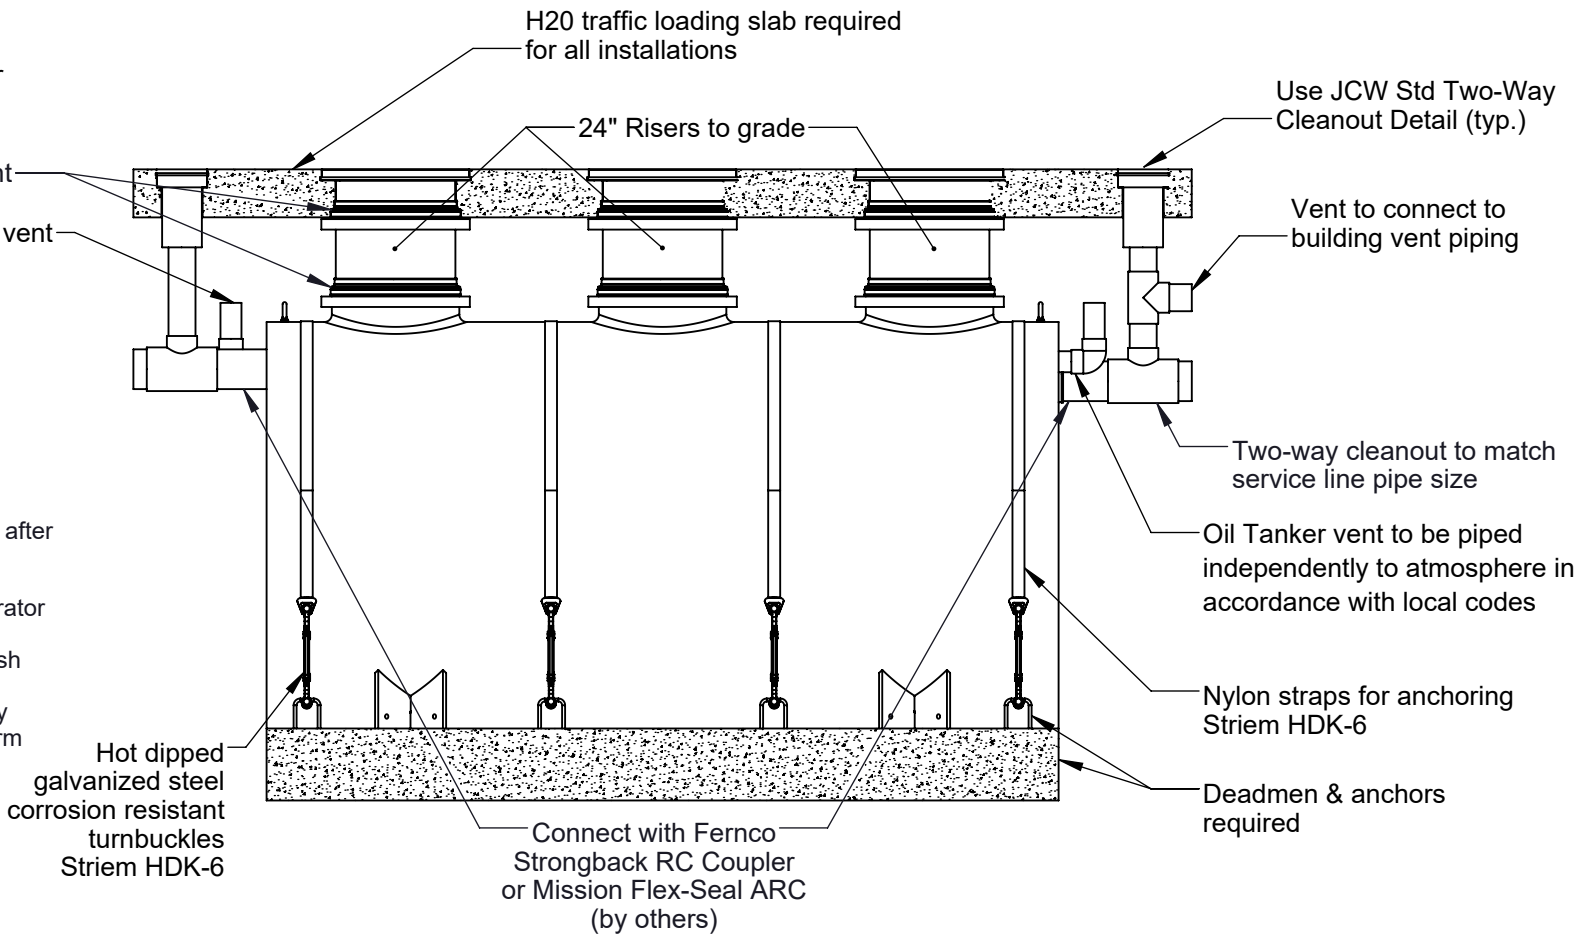


PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF STRIEM, LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF STRIEM, LLC. IS PROHIBITED. JCW IS ALLOWED PUBLICATION & DISTRIBUTION

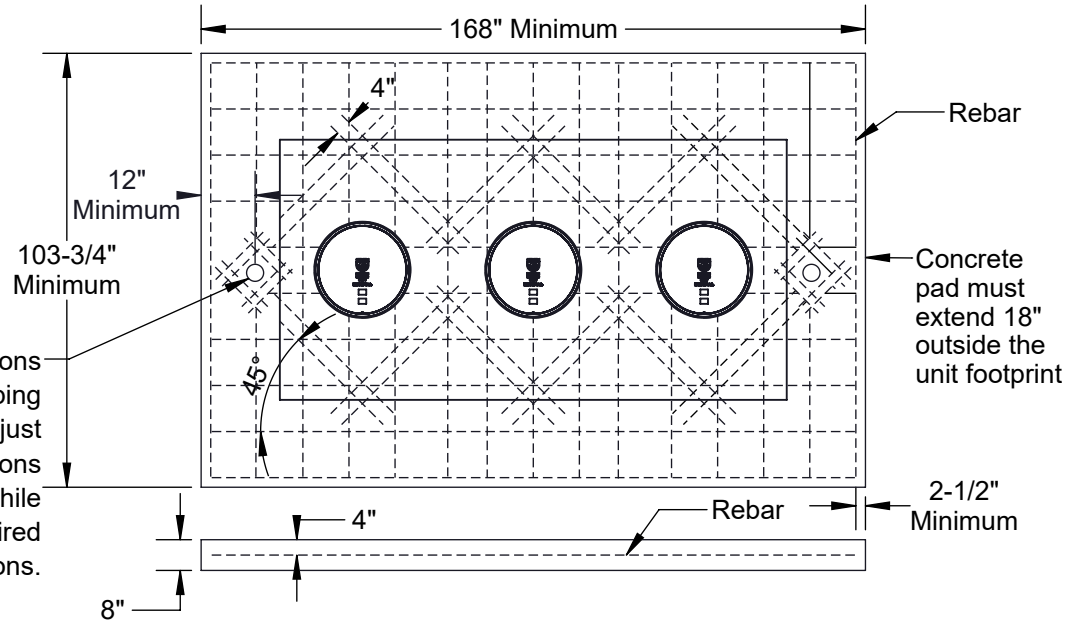

CONCRETE SLAB DETAIL

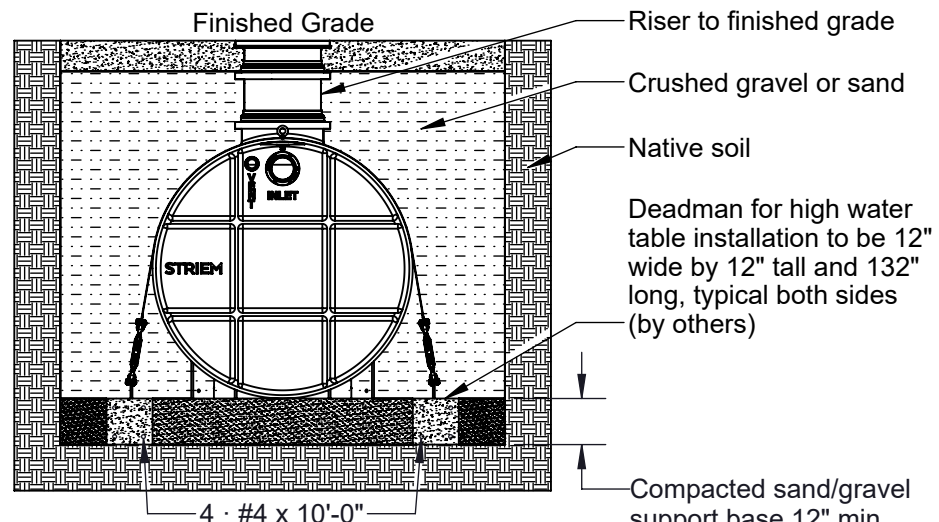

EXCAVATION AND BACKFILL DATA

SPECIFICATIONS


1. Max flow rate: 314 GPM.
2. Liquid capacity: 1500 Gallons (200.5 cu. ft.).
3. Oil capacity: 488 Gallons.
4. Solids/sediment capacity: 825 Gallons
5. Unit weight w/std. covers: 1676 lbs.
6. H2O rated pickable cast iron covers.
7. Maximum operating temperature 140°F continuous.

NOTES


1. 7/8" thick high density polyethylene walls.
2. Unit supplied with built-in adapter(s) for up to 5" of adjustability.
3. Additional riser(s) available for deeper burial depth.
4. For buried applications.
5. Lifting lug set included for easy install.

ENGINEER SPECIFICATION GUIDE


Striem oil separator model OT-1500-JCW shall be lifetime guaranteed and made in USA of High Density Polyethylene with minimum 7/8" uniform wall thickness. Separator shall be furnished for below grade installation with field adjustable riser system. Separator flow rate shall be 314 GPM. Separator oil capacity shall be 488 gallons. Sand capacity shall be 825 gallons. Separator shall be certified to IAPMO IGC 183-2016. Pickable cast iron cover shall provide water/gas-tight seal and be H2O traffic rated.



PE STAMP  
(For H2O Slab Design Only)




Hold Down Kit Required  
Unless Sealed by Kansas  
Professional Engineer

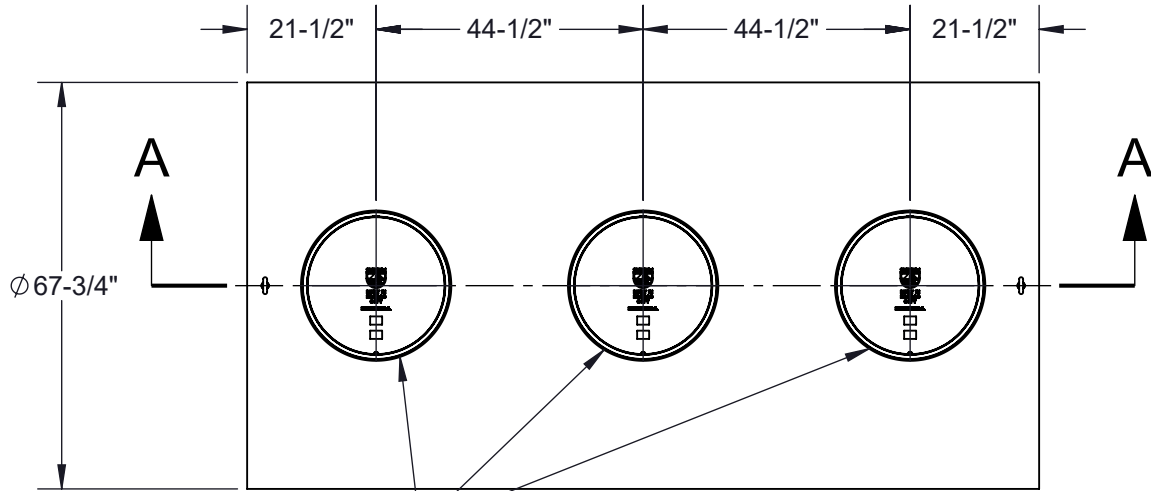


Adjustable adapters with H2O  
rated pickable cast iron covers


TOP VIEW

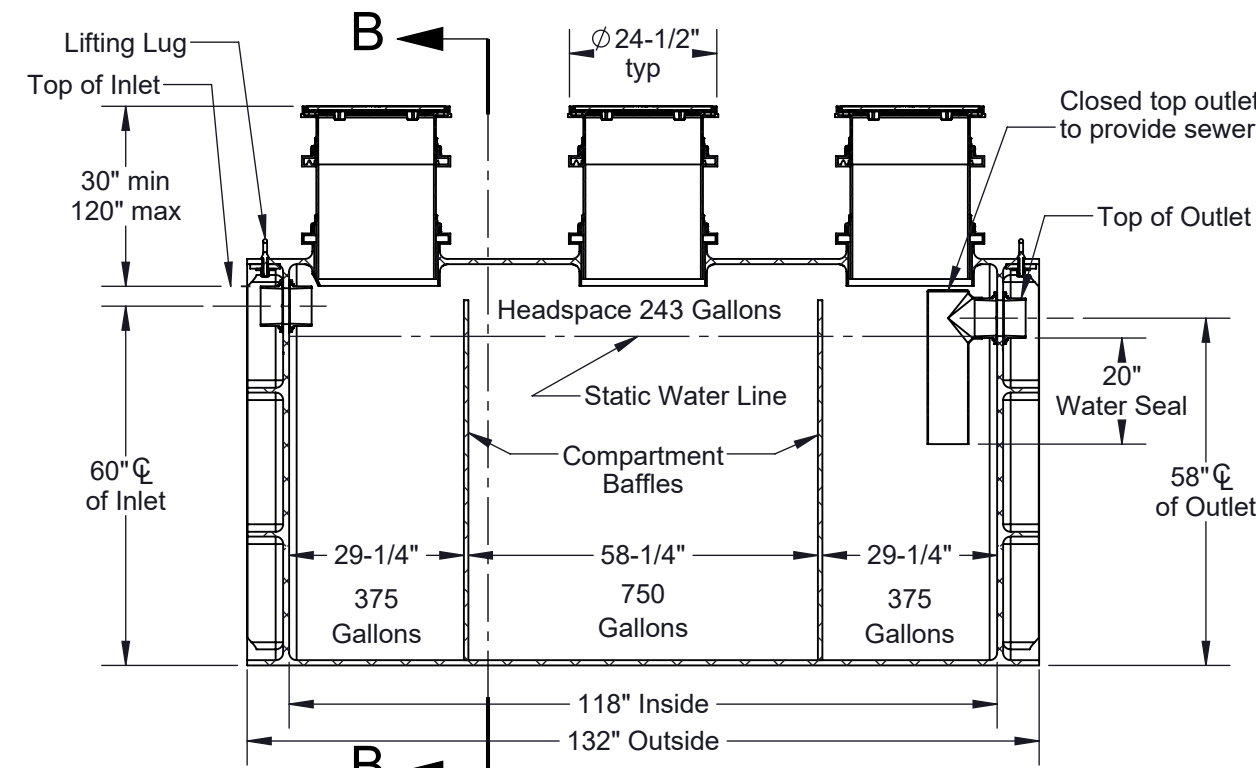


SECTION A-A

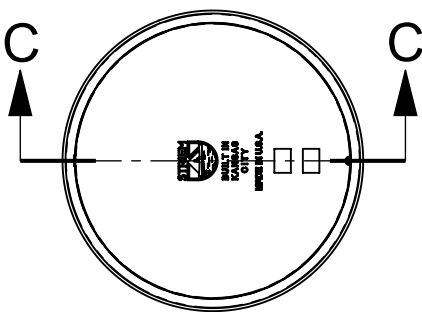

Pickable cast iron cover

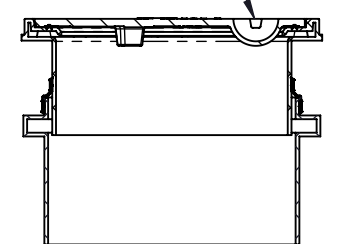

SECTION C-C

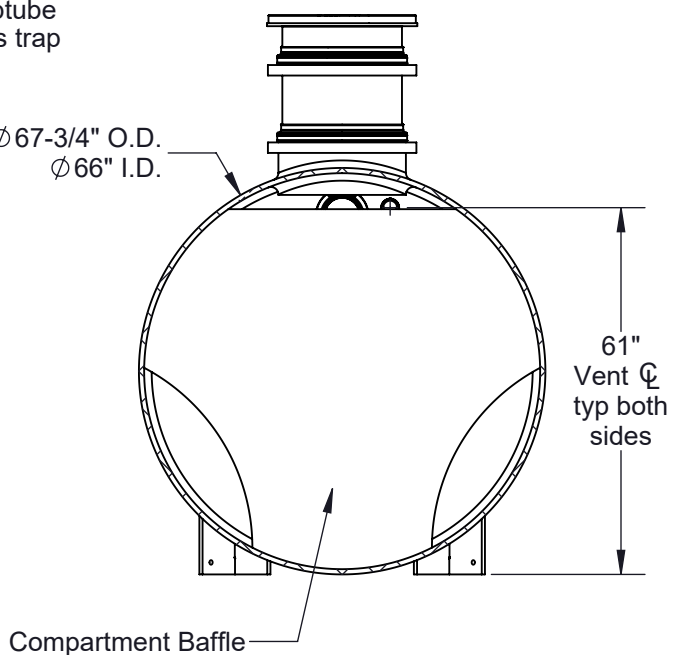

SECTION B-B

MODEL NUMBER: OT-1500-JCW

DESCRIPTION:

POLYETHYLENE OIL SEPARATOR  
314 GPM  
1500 GALLON CAPACITY  
JOHNSON COUNTY WASTEWATER DETAIL

DWG BY:ENG DATE: 1/12/2024 REV: 0

SPECIFICATION SHEET

**Striem**  
3100 Brinkerhoff  
Kansas City, KS 66115  
Tel: 913-222-1500  
orders@striemco.com  
www.striemco.com

Made in the U.S.A

